

Approval body for construction products  
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and  
Laender Governments



## European Technical Assessment

ETA-07/0025  
of 23 September 2020

English translation prepared by DIBt - Original version in German language

### General Part

Technical Assessment Body issuing the  
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

fischer High-Performance Anchor FH II, FH II-I

Product family  
to which the construction product belongs

Mechanical fastener for use in concrete

Manufacturer

fischerwerke GmbH & Co. KG  
Klaus-Fischer-Straße 1  
72178 Waldachtal  
DEUTSCHLAND

Manufacturing plant

fischerwerke

This European Technical Assessment  
contains

25 pages including 3 annexes which form an integral part  
of this assessment

This European Technical Assessment is  
issued in accordance with Regulation (EU)  
No 305/2011, on the basis of

EAD 330232-00-0601, Edition 10/2016

This version replaces

ETA-07/0025 issued on 28 August 2018

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

**Specific Part**

**1 Technical description of the product**

The Fischer High-Performance Anchor FH II, FH II-I is an anchor made of galvanised steel (sizes with external diameter 10, 12, 15, 18, 24, 28 and 32, sizes with internal thread 12/M6 I, 12/M8 I, 15/M10 I and 15/M12 I) or stainless steel (sizes with external diameter 10, 12, 15, 18 and 24, sizes with internal thread 12/M6 I, 12/M8 I, 15/M10 I and 15/M12 I) which is placed into a drilled hole and anchored by torque-controlled expansion.  
 The product description is given in Annex A.

**2 Specification of the intended use in accordance with the applicable European Assessment Document**

The performances given in Section 3 are only valid if the fastener is used in compliance with the specifications and conditions given in Annex B.  
 The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the fastener of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

**3 Performance of the product and references to the methods used for its assessment**

**3.1 Mechanical resistance and stability (BWR 1)**

| Essential characteristic   | Performance              |
|--|--------------------------|
| Characteristic resistance to tension load (static and quasi-static loading)              | See Annex C 1, C 2, C 7  |
| Characteristic resistance to shear load (static and quasi-static loading)                | See Annex C 3 and C4     |
| Displacements (static and quasi-static loading)  | See Annex C 10, C 11     |
| Characteristic resistance and displacements for seismic performance categories C1 and C2 | See Annex C 8, C 9, C 11 |
| Durability   | See Annex B 1            |

**3.2 Safety in case of fire (BWR 2)**

| Essential characteristic | Performance        |
|--------------------------|--------------------|
| Reaction to fire         | Class A1           |
| Resistance to fire       | See Annex C 5, C 6 |

**4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base**

In accordance with the European Assessment Document EAD 330232-01-0601 the applicable European legal act is: [96/582/EC].  
 The system to be applied is: 1

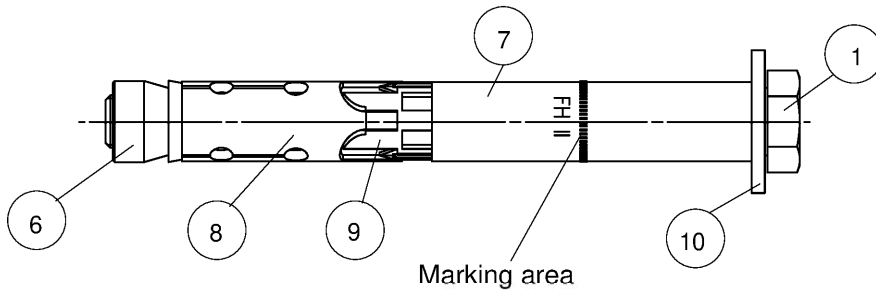
**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document**

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.

Issued in Berlin on 23 September 2020 by Deutsches Institut für Bautechnik

BD Dipl.-Ing. Andreas Kummerow  
Head of Department

*beglaubigt:*  
Baderschneider



Type hexagon screw **S**

FH II 10 - 32 S

FH II 10 - 24 S R

Product label, example:

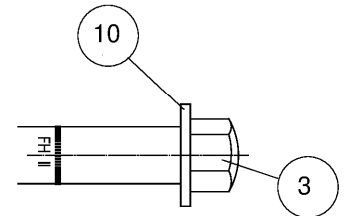
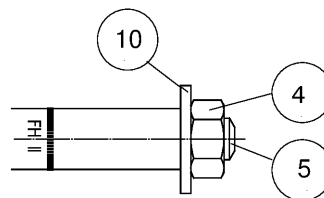
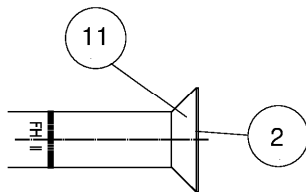


Brand

Identification R

Type of fastener

Nominal drill hole diameter/max. thickness of fixture ( $t_{fix}$ )



Type countersunk screw **SK**

FH II 10 - 18 SK

FH II 10 - 18 SK R

Type hexagon nut **B**

FH II 10 - 32 B

FH II 10 - 24 B R

Type cap nut **H**

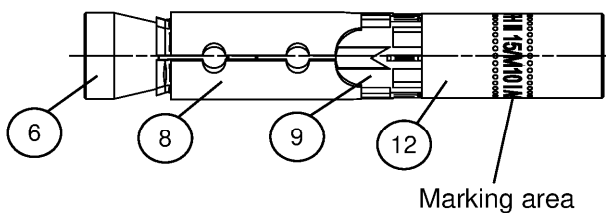
FH II 10 - 24 H

FH II 10 - 24 H R

- 1 Hexagon screw
- 2 Countersunk screw
- 3 Cap nut
- 4 Hexagon nut

- 5 Threaded rod
- 6 Cone nut
- 7 Distance sleeve
- 8 Expansion sleeve

- 9 Plastic sleeve
- 10 Washer
- 11 Conical washer
- 12 Internal thread socket




Type internal threaded anchor **I**

FH II 12 M6-I or M8-I

FH II 15 M10-I or M12-I

Product label, example:



Brand

Identification R

Type of fastener

Nominal drill hole diameter / size of internal thread


(Fig. not to scale)

fischer High-Performance Anchor FH II, FH II-I

**Product description**

Anchor types FH II, FH II R, FH II-I, FH II-I R

**Annex A 1**

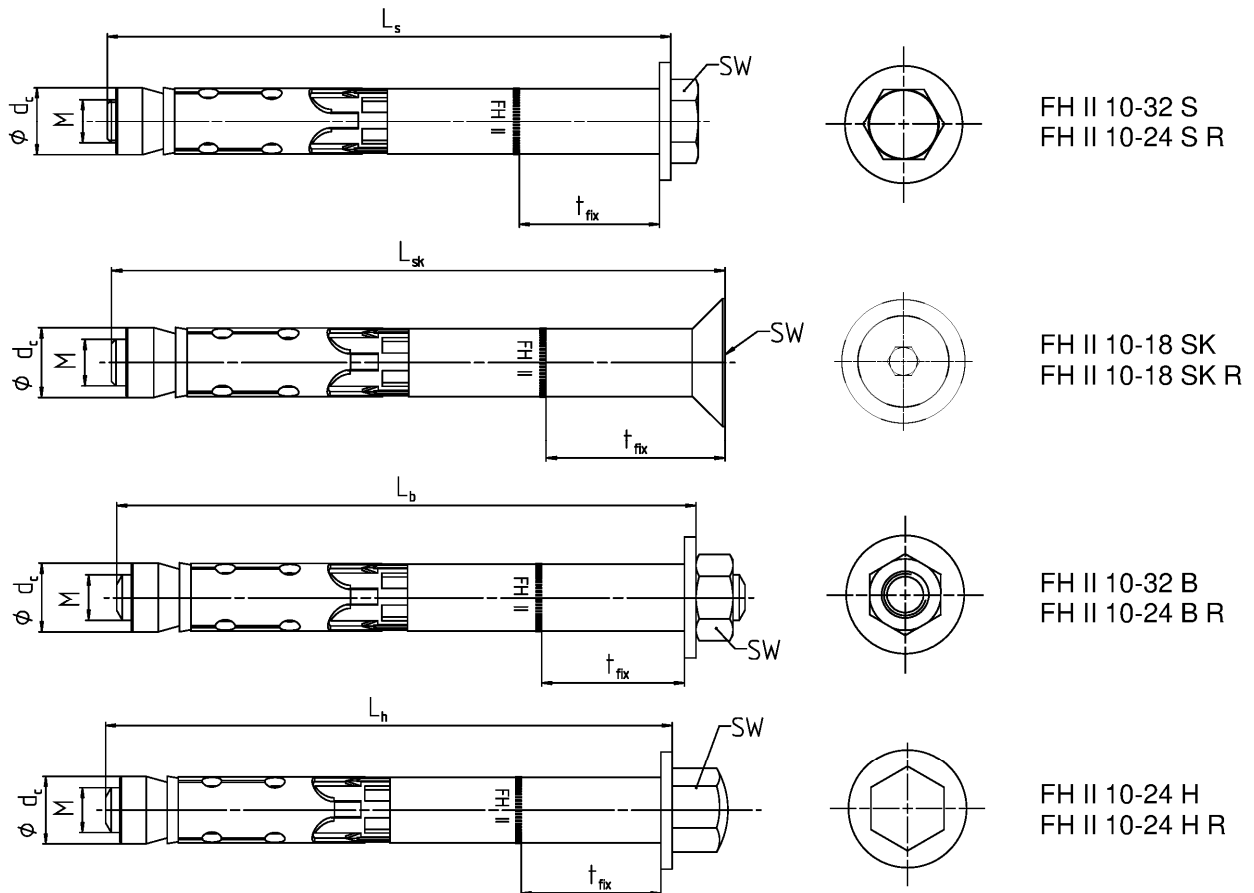

**Table A2.1:** Dimensions [mm] FH II and FH II R

| Anchor type  |  | FH II<br>10 | FH II<br>12 | FH II<br>15 | FH II<br>18 | FH II<br>24 | FH II<br>28 | FH II<br>32 |
|--|--|-------------|-------------|-------------|-------------|-------------|-------------|-------------|
| Thread   | M  | 6           | 8           | 10          | 12          | 16          | 20          | 24          |
| Diameter cone nut  | d <sub>c</sub>   | 10          | 12          | 14,8        | 17,8        | 23,7        | 27,5        | 31,5        |
| Wrench size SW   | FH II-S, -B  | 10          | 13          | 17          | 19          | 24          | 30          | 36          |
|  | FH II-SK <sup>1)</sup>   | 4           | 5           | 6           | 8           | 3)          |             |             |
|  | FH II-H  | 13          | 17          | 17          | 19          | 24          | 3)          |             |
|  | FH II-S R, -B R, -H R  | 10          | 13          | 17          | 19          | 24          | 3)          |             |
|  | FH II-SK R <sup>1)</sup>   | 4           | 5           | 6           | 8           | 3)          |             |             |
| t <sub>fix</sub> FH II-S, -B, -H + FH II-S R, -B R, -H R | min  | 0           | 0           | 0           | 0           | 0           | 0           | 0           |
| t <sub>fix</sub> FH II-SK + FH II-SK R <sup>2)</sup>     | min  | 5           | 6           | 6           | 8           | 3)          |             |             |
| Length of screw / bolt                                   | L <sub>s</sub> , L <sub>h</sub> , L <sub>b</sub> (- t <sub>fix</sub> ) | ≥ 49        | ≥ 74        | ≥ 89        | ≥ 99        | ≥ 124       | ≥ 149       | ≥ 174       |
| Length of countersunk screw                              | L <sub>sk</sub> (- t <sub>fix</sub> )                                  | ≥ 54        | ≥ 79        | ≥ 95        | ≥ 107       | 3)          |             |             |

<sup>1)</sup> Internal hexagon

<sup>2)</sup> The influence of the thickness of fixture to the characteristic resistance for shear loads, steel failure without lever arm is taken into account, see tables C3.1, C8.1 and C9.1

<sup>3)</sup> Anchor type not part of assessment

(Fig. not to scale)


fischer High-Performance Anchor FH II, FH II-I

**Product description**

Anchor types and dimensions FH II, FH II R

**Annex A 2**

| <b>Table A3.1: Material FH II and FH II R</b>             |                   |  |  |
|---|-------------------|--|--|
| No.   | Designation       | Material   |  |
|   |                   | FH II  | FH II R  |
|   | Steel grade       | Steel  | Stainless steel R  |
|   |                   | Zinc plated $\geq 5 \mu\text{m}$ ,<br>ISO 4042:2018                          | Acc. to EN 10088:2014  |
| 1   | Hexagon screw     | Steel class 8.8; EN ISO 898-1:2013   | Class 80<br>EN ISO 3506:2020   |
| 2   | Countersunk screw |  |  |
| 3   | Cap nut           |  |  |
| 4   | Hexagon nut       |  |  |
|   |                   | Steel class 8  |  |
| 5   | Threaded rod      | Steel<br>$f_{uk} \geq 800 \text{ N/mm}^2$ ; $f_{yk} \geq 640 \text{ N/mm}^2$ | Stainless steel EN 10088:2014<br>$f_{uk} \geq 800 \text{ N/mm}^2$ ; $f_{yk} \geq 640 \text{ N/mm}^2$ |
| 6   | Cone nut          | Steel EN 10277:2018  | Stainless steel EN 10088:2014  |
| 7   | Distance sleeve   | Steel EN 10305:2016  |  |
| 8   | Expansion sleeve  | Steel EN 10139:2020/ EN 10277:2018   |  |
| 9   | Plastic sleeve    | ABS (plastic)  |  |
| 10  | Washer            | Steel EN 10139:2020  | Stainless steel EN 10088:2014  |
| 11  | Conical washer    | Steel EN 10277:2018  |  |
| fischer High-Performance Anchor FH II, FH II-I            |                   |  | <b>Annex A 3</b>   |
| <b>Product description</b><br>Materials FH II and FH II R |                   |  |  |

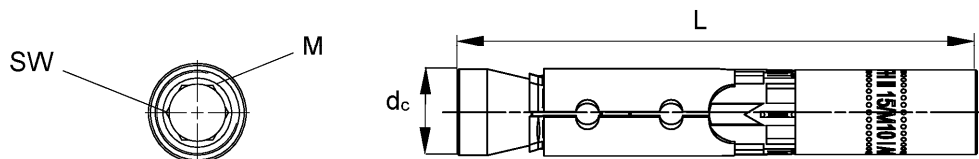

**Table A4.1:** Anchor Dimensions [mm] FH II-I and FH II-I R

| Anchor type FH II-I, FH II-I R |                | FH II<br>12/M6 I | FH II<br>12/M8 I | FH II<br>15/M10 I | FH II<br>15/M12 I |
|--------------------------------|----------------|------------------|------------------|-------------------|-------------------|
| Thread                         | M              | 6                | 8                | 10                | 12                |
| Diameter cone nut              | d <sub>c</sub> | 12               | 12               | 14,8              | 14,8              |
| Wrench size internal hexagon   | SW             | 6                | 8                | 6                 | 8                 |
| Anchor length                  | L              | 77,5             | 77,5             | 90                | 90                |

**Table A4.2:** Material FH II-I and FH II-I R

| No.                              | Designation          | Material  |   |
|----------------------------------|----------------------|---|---|
|                                  |                      | FH II-I   | FH II-I R   |
|                                  | Steel grade          | Steel   | Stainless steel R   |
|                                  |                      | Zinc plated $\geq 5 \mu\text{m}$ ,<br>ISO 4042:2018   | Acc. to EN 10088:2014   |
| 6                                | Cone nut             | Steel EN 10277:2018   | Stainless steel EN 10088:2014   |
| 8                                | Expansion sleeve     | Steel EN 10139:2020 / EN 10277:2018   |   |
| 9                                | Plastic sleeve       | ABS (plastic)   |   |
| 12                               | Internal thread bolt | Steel EN 10277:2018<br>$f_{uk} \geq 750 \text{ N/mm}^2$ ,<br>$f_{yk} \geq 600 \text{ N/mm}^2$ | Stainless steel EN 10088:2014<br>$f_{uk} \geq 750 \text{ N/mm}^2$ ,<br>$f_{yk} \geq 600 \text{ N/mm}^2$ |
| Requirements for fixing elements |                      | Steel strength class 5.8, 6.8 or 8.8<br>EN ISO 898-1:2013                                     | Steel strength class A50, A70 or A80 EN<br>ISO 3506:2010<br>1.4362, 1.4401, 1.4404, 1.4571, 1.4529      |

(Fig. not to scale)



fischer High-Performance Anchor FH II, FH II-I


**Product description**

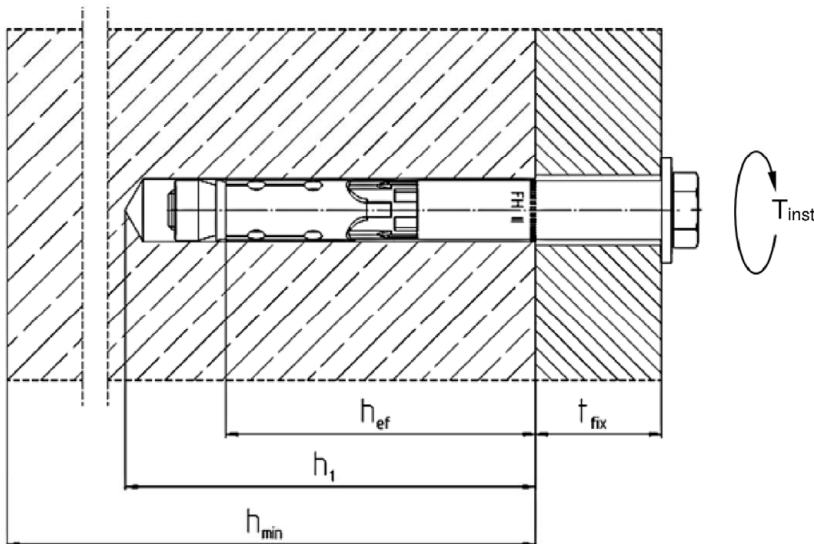Anchor types, dimensions and materials FH II-I, FH II I-R

**Annex A 4**



| Specifications of intended use  |   |    |    |    |    |                  |       |
|---|---|----|----|----|----|------------------|-------|
| Anchorages subject to:  |   |    |    |    |    |                  |       |
| Size  |   | 10 | 12 | 15 | 18 | 24               | 28 32 |
| High Performance Anchor   | FH II-S, -B   |    |    |    | ✓  |                  |       |
|   | FH II-H, -S R, -B R, -H R   |    |    | ✓  |    |                  | 1)    |
|   | FH II-SK, FH II-SK R  |    | ✓  |    |    |                  | 1)    |
| High Performance Anchor FH II-I, FH II-I R  |   | 1) | ✓  |    |    |                  | 1)    |
| Hammer drilling with standard drill bit   |  |    |    |    |    |                  |       |
| Hammer drilling with hollow drill bit with automatic cleaning   |  |    |    |    | ✓  |                  |       |
| Static and quasi-static loads   |   |    |    |    |    |                  |       |
| Cracked and uncracked concrete  |   |    |    |    | ✓  |                  |       |
| Fire exposure   |   |    |    |    |    |                  |       |
| Seismic performance category  | C1 FH II  |    |    |    |    | ✓                |       |
|   | C1 FH II R  | 2) |    | ✓  |    |                  | 1)    |
|   | C2 FH II  |    |    |    |    | ✓                |       |
|   | C2 FH II R  |    |    | ✓  |    |                  | 1)    |
|   | C1 FH II-I, FH II-I R   | 1) | 2) |    |    |                  | 1)    |
|   | C2 FH II-I, FH II-I R   |    |    |    |    |                  |       |
| <p>1) Anchor type not part of the assessment</p> <p>2) No performance assessed</p>  |   |    |    |    |    |                  |       |
| <p><b>Base materials:</b></p> <ul style="list-style-type: none"> <li>• Compacted reinforced or unreinforced normal weight concrete without fibres (cracked and uncracked) of strength classes C20/25 to C50/60 according to EN 206:2013+A1:2016</li> </ul>  |   |    |    |    |    |                  |       |
| <p><b>Use conditions (Environmental conditions):</b></p> <ul style="list-style-type: none"> <li>• Structures subject to dry internal conditions (FH II, FH II R, FH II-I, FH II-I R)</li> <li>• Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal conditions, if no particular aggressive conditions exist (FH II R, FH II-I R)</li> </ul> <p>Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where deicing materials are used)</p> |   |    |    |    |    |                  |       |
| <p><b>Design:</b></p> <ul style="list-style-type: none"> <li>• Anchorages are to be designed under the responsibility of an engineer experienced in anchorages and concrete work</li> <li>• Verifiable calculation notes and drawings are to be prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.)</li> <li>• Design of fastenings according to EN 1992-4:2018 and EOTA Technical Report TR 055, Edition February 2018</li> </ul>   |   |    |    |    |    |                  |       |
| fischer High-Performance Anchor FH II, FH II-I  |   |    |    |    |    | <b>Annex B 1</b> |       |
| <b>Intended use Specifications</b>  |   |    |    |    |    |                  |       |



- $h_{ef}$  = Effective embedment depth
- $t_{fix}$  = Thickness of the fixture
- $h_1$  = Depth of drill hole to deepest point
- $h_{min}$  = Minimum thickness of concrete member
- $T_{inst}$  = Required setting torque

**Table B2.1:** Installation parameters FH II and FH II R

| Anchor type FH II S, -SK, -B, -H and FH II S R, -SK R, -B R, -H R | FH II 10             | FH II 12 | FH II 15 | FH II 18 | FH II 24 | FH II 28 | FH II 32 |     |
|---|----------------------|----------|----------|----------|----------|----------|----------|-----|
| Nominal drill hole diameter $d_0$                                 | 10                   | 12       | 15       | 18       | 24       | 28       | 32       |     |
| Maximum diameter of drill bit $d_{cut} \leq$                      | 10,45                | 12,50    | 15,50    | 18,50    | 24,55    | 28,55    | 32,70    |     |
| Depth of drill hole to deepest $h_1 \geq$                         | 55                   | 80       | 90       | 105      | 125      | 155      | 180      |     |
| Diameter of clearance hole $d_f \leq$                             | 12                   | 14       | 17       | 20       | 26       | 31       | 35       |     |
| Diameter of counter sunk FH II SK                                 | 18                   | 22       | 25       | 32       | 1)       |          |          |     |
| Depth of counter sunk, 90° FH II SK R                             | 5,0                  | 5,8      | 5,8      | 8,0      |          |          |          |     |
| Required setting torque $T_{inst}$ [Nm]                           | FH II S              | 22,5     | 40       | 80       | 160      | 180      | 200      |     |
|   |                      | FH II B  | 17,5     |          | 38       | 120      | 180      | 200 |
|   |                      | FH II H  | 22,5     |          | 40       | 90       | 1)       |     |
|   | FH II SK             | 1)       |          |          |          |          |          |     |
|   | FH II S R, FH II B R | 15       | 25       | 40       | 100      | 160      | 1)       |     |
|   | FH II H R            | 10       |          |          |          | 1)       |          |     |
| FH II SK R  | 1)                   |          |          |          |          |          |          |     |


1) Anchor type not part of assessment

(Fig. not to scale)

fischer High-Performance Anchor FH II, FH II-I

**Intended use**  
Installation parameters FH II, FH II R

**Annex B 2**

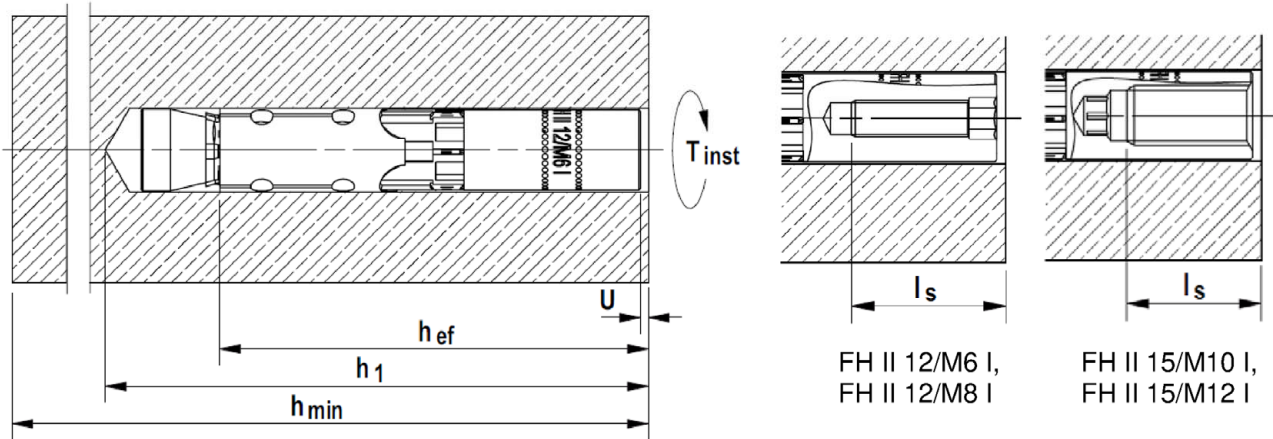

- $h_{ef}$  = Effective embedment depth
- $h_1$  = Depth of drill hole to deepest point
- $h_{min}$  = Minimum thickness of concrete member
- $T_{inst}$  = Required setting torque
- $U$  = Required gap after torquing
- $l_s$  = Screw-in depth

**Table B3.1:** Installation parameters FH II-I and FH II-I R

| Anchor type FH II-I and FH II-I R   |                     | FH II<br>12/M6 I | FH II<br>12/M8 I | FH II<br>15/M10 I | FH II<br>15/M12 I |
|---|---------------------|------------------|------------------|-------------------|-------------------|
| Nominal drill hole diameter   | $d_0$               | 12               |                  | 15                |                   |
| Maximum bit diameter  | $d_{cut} \leq$      | 12,50            |                  | 15,50             |                   |
| Depth of drill hole   | $h_1 \geq$ [mm]     | 85               |                  | 95                |                   |
| Diameter of clearance hole  | $d_f \leq$          | 7                | 9                | 12                | 14                |
| Required gap after torquing <sup>1)</sup>   | $U$                 | 3 - 5            |                  |                   |                   |
| Required setting torque <sup>1)</sup>   | $T_{inst}$ [Nm]     | 15               |                  | 25                |                   |
| Minimum screw-in depth  | $l_s \geq$          | 11 + U           | 13 + U           | 10 + U            | 12 + U            |
| Maximum screw-in depth  | $l_s \leq$ [mm]     | 20 + U           |                  |                   |                   |
| Maximum torque on fixture in combination with screws and threaded rods strength class $\geq 5.8$ resp. $\geq A50$ | $\max T_{fix}$ [Nm] | 3                | 8                | 15                | 20                |

<sup>1)</sup> At least one of the requirements concerning the gap  $U$  or the required setting torque  $T_{inst}$  have to be fulfilled

(Fig. not to scale)

fischer High-Performance Anchor FH II, FH II-I

**Intended use**  
Installation parameters FH II-I, FH II-I R

**Annex B 3**

### Installation instructions:

















- Fastener installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- Use of the fastener only as supplied by the manufacturer without exchanging the components of the fastener
- Checking before placing the fastener to ensure that the strength class of the concrete in which the fastener is to be placed is in the range given and is not lower than that of the concrete to which the characteristic loads apply
- Check of concrete being well compacted, e.g. without significant voids
- Hammer or hollow drilling according to Annex B5 and B6
- Drill hole created perpendicular  $\pm 5^\circ$  to concrete surface, positioning without damaging the reinforcement
- In case of aborted hole: new drilling at a minimum distance twice the depth of the aborted drill hole or smaller distance if the aborted drill hole is filled with high strength mortar and if under shear or oblique tension load it is not in the direction of load application

fischer High-Performance Anchor FH II, FH II-I



**Intended Use**  
Installation instructions

**Annex B 4**

Installation instruction for the fischer High-Performance anchor  
FH II 10 - FH II 32 and FH II 10 R - FH II 24 R







|  |  |  |  |  |  |
|--|--|--|--|--|--|
| <b>Hollow drilling</b>   |   | Continue with step 3, 4 and 5  |  |  |  |
|  |   |   |   |   |   |
| <b>Hammer drilling</b>   | Installation instruction FH II 10 - 32 S and FH II 10 - 24 S R                     |  |  |  |  |
|  |   |   |   |   |   |
|  | Installation instruction FH II 10 - 18 SK and FH II 10 - 18 SK R                   |  |  |  |  |
|  |  |  |  |  |  |
| Installation instruction FH II 10 - 32 B and FH II 10 - 24 B R |  |  |  |  |  |
| Installation instruction FH II 10 - 24 H and FH II 10 - 24 H R |  |  |  |  |  |
| Step   | <b>1</b>   | <b>2</b>   | <b>3</b>   | <b>4</b>   | <b>5</b>   |

| Step | Description                         |  |
|------|-------------------------------------|--|
| 1    | Create drill hole with hammer drill | Create drill hole with hollow drill and vacuum cleaner |
| 2    | Clean the hole                      | -  |
| 3    | Set the fastener                    |  |
| 4    | Apply $T_{inst}$                    |  |
| 5    | Installed fastener                  |  |

| Types of drill bits |   |
|---------------------|---|
| Hammer drill        |  |
| Hollow drill        |  |

|   |                  |
|---|------------------|
| fischer High-Performance Anchor FH II, FH II-I                  | <b>Annex B 5</b> |
| <b>Intended use</b><br>Installation instructions FH II, FH II R |                  |

Installation instruction for the fischer High-Performance anchor internal thread  
**FH II-I and FH II-I R**

|                            |   |   |   |  |   |
|----------------------------|---|---|---|--|---|
| <b>Hollow<br/>drilling</b> |  | Continue with step 2, 3, and 4  |   |  |   |
| <b>Hammer<br/>drilling</b> |  |  |  |  |  |
| Step                       | 1   | 2   | 3   | 4  |   |

| Step | Description   |  |
|------|---|--|
| 1    | Create drill hole with hammer drill,<br>clean drill hole  | Create<br>drill hole with hollow drill<br>and vacuum cleaner |
| 2    | Hammering in the anchor flushed with the surface of the concrete  |  |
| 3    | Tighten the anchor. The included hexagon bit in the package should be used. Other tightening methods are allowed.<br>Tighten the anchor in the concrete until the gap U is 3 - 5 mm or the required setting torque $T_{inst}$ is reached. Only one of the above requirements has to be fulfilled.   |  |
| 4    | Attach the fixture and use a suitable screw or anchor rod. The length of the screw or anchor rod should be determined depending on the thickness of fixture $t_{fix}$ , admissible tolerances, and available thread length $l_{s,max}$ and $l_{s,min}$ including the gap U.<br>Tighten the screw with the torque $\leq \max T_{fix}$ ( $\max T_{fix}$ see table B3.1) |  |

Types of drill bits

Hammer drill



Hollow drill



fischer High-Performance Anchor FH II, FH II-I

**Intended use**  
Installation instructions FH II-I, FH II-I R

**Annex B 6**

| <b>Table C1.1: Performance characteristics of tension resistance under static and quasi-static loads for FH II and FH II R</b>   |  |  |  |                 |                 |  |                 |                 |                  |                 |       |      |
|--|--|--|--|-----------------|-----------------|--|-----------------|-----------------|------------------|-----------------|-------|------|
| Anchor type FH II-S, -SK, -B, -H and FH II-S R, -SK R, -B R, -H R  |  |  |  | <b>FH II 10</b> | <b>FH II 12</b> | <b>FH II 15</b>                                | <b>FH II 18</b> | <b>FH II 24</b> | <b>FH II 28</b>  | <b>FH II 32</b> |       |      |
| <b>Steel failure</b>   |  |  |  |                 |                 |  |                 |                 |                  |                 |       |      |
| FH II-S, -B,   |  |  |  | 16,1            | 29,3            | 46,4   | 67,4            | 125,3           | 195,8            | 282,0           |       |      |
| FH II-H, FH II-H R, -B R   |  |  |  | $N_{Rk,s}$      | [kN]            | 16,1   | 29,3            | 46,4            | 67,4             | 125,3           | 2)    |      |
| FH II-SK   |  |  |  |                 |                 | 16,1   | 29,3            | 46,4            | 67,4             | 2)              |       |      |
| Partial factor   |  |  |  | $\gamma_{Ms}$   | 1)              | [-]  |                 |                 |                  |                 | 1,5   |      |
| FH II-S R  |  |  |  | $N_{Rk,s}$      | [kN]            | 16,1   | 29,3            | 46,4            | 67,4             | 125,3           | 2)    |      |
| FH II-SK R   |  |  |  |                 |                 | 16,1   | 29,3            | 46,4            | 67,4             | 2)              |       |      |
| Partial factor   |  |  |  | $\gamma_{Ms}$   | 1)              | [-]  |                 |                 |                  |                 | 1,6   |      |
| <b>Pullout failure</b>   |  |  |  |                 |                 |  |                 |                 |                  |                 |       |      |
| Characteristic resistance in cracked concrete C20/25 FH II and FH II R   |  |  |  | $N_{Rk,p}$      | [kN]            | 7,5  | 12,0            | 16,0            | 25,0             | 34,4            | 48,1  | 63,3 |
| Characteristic resistance in uncracked concrete C20/25 FH II   |  |  |  |                 |                 | 12,5   | 22,9            | 28,8            | 35,2             | 49,2            | 68,8  | 90,4 |
| Characteristic resistance in uncracked concrete C20/25 FH II R   |  |  |  |                 |                 | 12,5   | 20,0            | 28,8            | 35,2             | 49,2            | 2)    |      |
| Increasing factors for $N_{Rk,p}$ for cracked and uncracked concrete   |  |  |  | $\psi_c$        | C25/30          | 1,12   |                 |                 |                  |                 |       |      |
|  |  |  |  |                 | C30/37          | 1,22   |                 |                 |                  |                 |       |      |
|  |  |  |  |                 | C35/45          | 1,32   |                 |                 |                  |                 |       |      |
|  |  |  |  |                 | C40/50          | 1,41   |                 |                 |                  |                 |       |      |
|  |  |  |  |                 | C45/55          | 1,50   |                 |                 |                  |                 |       |      |
|  |  |  |  |                 | C50/60          | 1,58   |                 |                 |                  |                 |       |      |
| Installation factor  |  |  |  | $\gamma_{Inst}$ | [-]             | 1,0  |                 |                 |                  |                 |       |      |
| <b>Concrete cone failure and splitting failure</b>   |  |  |  |                 |                 |  |                 |                 |                  |                 |       |      |
| Effective embedment depth  |  |  |  | $h_{ef}$        | [mm]            | 40   | 60              | 70              | 80               | 100             | 125   | 150  |
| Factor for cracked concrete  |  |  |  | $k_{cr,N}$      | [-]             | 7,7 <sup>3)</sup>                              |                 |                 |                  |                 |       |      |
| Factor for uncracked concrete  |  |  |  | $k_{ucr,N}$     |                 | 11,0 <sup>3)</sup>                             |                 |                 |                  |                 |       |      |
| Spacing  |  |  |  | $s_{cr,N}$      |                 | 120  | 180             | 210             | 240              | 300             | 375   | 450  |
| Edge distance  |  |  |  | $c_{cr,N}$      | [mm]            | 60   | 90              | 105             | 120              | 150             | 187,5 | 225  |
| Spacing (splitting)  |  |  |  | $s_{cr,sp}$     |                 | 190  | 300             | 320             | 340              | 380             | 480   | 570  |
| Edge distance (splitting)  |  |  |  | $c_{cr,sp}$     |                 | 95   | 150             | 160             | 170              | 190             | 240   | 285  |
| Characteristic resistance (splitting)  |  |  |  | $N_{Rk,sp}^0$   | [kN]            | min $\{N_{Rk,c}^0, N_{Rk,p}^0\}$ <sup>4)</sup> |                 |                 |                  |                 |       |      |
| <p>1) In absence of other national regulations</p> <p>2) Anchor type no performance assessed</p> <p>3) Based on concrete strength as cylinder strength</p> <p>4) <math>N_{Rk,c}^0</math> acc. EN 1992-4:2018</p> |  |  |  |                 |                 |  |                 |                 |                  |                 |       |      |
| fischer High-Performance Anchor FH II, FH II-I   |  |  |  |                 |                 |  |                 |                 | <b>Annex C 1</b> |                 |       |      |
| <b>Performances</b><br>Performance characteristics of tension resistance for FH II and FH II R   |  |  |  |                 |                 |  |                 |                 |                  |                 |       |      |

| <b>Table C2.1: Performance characteristics of tension resistance under static and quasi-static loads for FH II-I and FH II-I R</b>  |                        |                                   |                  |                   |                   |
|---|------------------------|-----------------------------------|------------------|-------------------|-------------------|
| Anchor type FH II-I and FH II-I R   |                        | FH II<br>12/M6 I                  | FH II<br>12/M8 I | FH II<br>15/M10 I | FH II<br>15/M12 I |
| <b>Steel failure</b>  |                        |                                   |                  |                   |                   |
| <b>Anchor in combination with screw / threaded rod of galvanised steel complying with DIN EN ISO 898</b>  |                        |                                   |                  |                   |                   |
| Strength class 5.8  |                        | 10                                | 19               | 29                | 43                |
| Strength class 6.8  | $N_{Rk,s}$ [kN]        | 12                                | 23               | 35                | 44                |
| Strength class 8.8  |                        | 16                                | 27               | 44                | 44                |
| Partial factor  | $\gamma_{Ms}^{1)}$ [-] | 1,5                               |                  |                   |                   |
| <b>Anchor in combination with screw / threaded rod of stainless steel complying with DIN EN ISO 3506</b>  |                        |                                   |                  |                   |                   |
| Screw/thread strength class A50   | $N_{Rk,s}$ [kN]        | 10                                | 19               | 29                | 43                |
| Partial factor  | $\gamma_{Ms}^{1)}$ [-] | 2,86                              |                  |                   |                   |
| Screw/thread strength class A70   | $N_{Rk,s}$ [kN]        | 14                                | 26               | 41                | 54                |
| Partial factor  | $\gamma_{Ms}^{1)}$ [-] | 1,87                              |                  |                   |                   |
| Screw/thread strength class A80   | $N_{Rk,s}$ [kN]        | 16                                | 29               | 46                | 46                |
| Partial factor  | $\gamma_{Ms}^{1)}$ [-] | 1,60                              |                  |                   |                   |
| <b>Pullout failure</b>  |                        |                                   |                  |                   |                   |
| Characteristic resistance in cracked concrete C20/25  | $N_{Rk,p}$ [kN]        | 9,0                               |                  | 12,0              |                   |
| Characteristic resistance in uncracked concrete C20/25  |                        | 20,0                              |                  | 28,8              |                   |
| Increasing factors for $N_{Rk,p}$ for cracked and uncracked concrete  | $\psi_c$               | C25/30                            | 1,12             |                   |                   |
|   |                        | C30/37                            | 1,22             |                   |                   |
|   |                        | C35/45                            | 1,32             |                   |                   |
|   |                        | C40/50                            | 1,41             |                   |                   |
|   |                        | C45/55                            | 1,50             |                   |                   |
|   |                        | C50/60                            | 1,58             |                   |                   |
| Installation factor   | $\gamma_{inst}$ [-]    | 1,0                               |                  |                   |                   |
| <b>Concrete cone failure and splitting failure</b>  |                        |                                   |                  |                   |                   |
| Effective embedment depth   | $h_{ef}$ [mm]          | 60                                |                  | 70                |                   |
| Factor for cracked concrete   | $k_{cr,N}$ [-]         | 7,7 <sup>2)</sup>                 |                  |                   |                   |
| Factor for uncracked concrete   | $k_{ucr,N}$ [-]        | 11,0 <sup>2)</sup>                |                  |                   |                   |
| Spacing   | $s_{cr,N}$             | 180                               |                  | 210               |                   |
| Edge distance   | $c_{cr,N}$ [mm]        | 90                                |                  | 105               |                   |
| Spacing (splitting)   | $s_{cr,sp}$            | 300                               |                  | 320               |                   |
| Edge distance (splitting)   | $c_{cr,sp}$            | 150                               |                  | 160               |                   |
| Characteristic resistance (splitting)   | $N_{Rk,sp}^0$ [kN]     | min $\{N_{Rk,c}^0, N_{Rk,p}\}^3)$ |                  |                   |                   |
| <sup>1)</sup> In absence of other national regulations<br><sup>2)</sup> Based on concrete strength as cylinder strength<br><sup>3)</sup> $N_{Rk,c}^0$ acc. EN 1992-4:2018 |                        |                                   |                  |                   |                   |
| fischer High-Performance Anchor FH II, FH II-I  |                        |                                   |                  | <b>Annex C 2</b>  |                   |
| <b>Performances</b><br>Performance characteristics of tension resistance for FH II-I and FH II-I R  |                        |                                   |                  |                   |                   |



| <b>Table C3.1: Performance characteristics of shear resistance for FH II and FH II R under static and quasi-static loads</b>  |  |  |                     |                 |                 |                 |                 |                  |                 |  |
|---|--|--|---------------------|-----------------|-----------------|-----------------|-----------------|------------------|-----------------|--|
| Anchor type FH II-S, -SK, -B, -H and FH II-S R, -SK R, -B R, -H R   |  |  | <b>FH II 10</b>     | <b>FH II 12</b> | <b>FH II 15</b> | <b>FH II 18</b> | <b>FH II 24</b> | <b>FH II 28</b>  | <b>FH II 32</b> |  |
| Installation factor $\gamma_{inst}$ [-]   |  |  | 1,0                 |                 |                 |                 |                 |                  |                 |  |
| <b>Steel failure without lever arm</b>  |  |  |                     |                 |                 |                 |                 |                  |                 |  |
| FH II-S   |  |  | 18,0                | 33,0            | 59,0            | 76,0            | 146,0           | 176,4            | 217,0           |  |
| FH II-B $V^0_{Rk,s}$ [kN]   |  |  | 16,0                | 27,2            | 42,8            | 61,9            | 119,0           | 148,8            | 169,0           |  |
| FH II-H   |  |  | 16,0                | 27,2            | 42,8            | 61,9            | 119,0           | 3)               |                 |  |
| FH II-SK  |  |  | $t_{fix}^{2)}$ [mm] | $\geq 10$       |                 | $\geq 15$       |                 | 3)               |                 |  |
|   |  |  | $V^0_{Rk,s}$ [kN]   | 18,0            | 33,0            | 59,0            | 76,0            |                  |                 |  |
|   |  |  | $t_{fix}^{2)}$ [mm] | $< 10$          |                 | $< 15$          |                 |                  |                 |  |
|   |  |  | $V^0_{Rk,s}$ [kN]   | 8,0             | 14,0            | 23,0            | 34,0            |                  |                 |  |
| Partial factor $\gamma_{Ms}^{1)}$ [-]   |  |  | 1,25                |                 |                 |                 |                 |                  |                 |  |
| Factor for ductility $k_7$  |  |  | 1,0                 |                 |                 |                 |                 |                  |                 |  |
| FH II-S R $V^0_{Rk,s}$ [kN]   |  |  | 18,0                | 33,0            | 59,0            | 76,0            | 146,0           | 3)               |                 |  |
| Partial factor $\gamma_{Ms}^{1)}$ [-]   |  |  | 1,33                |                 |                 |                 |                 |                  |                 |  |
| FH II-B R, -H R $V^0_{Rk,s}$ [kN]   |  |  | 16,0                | 27,2            | 42,8            | 61,9            | 119,0           | 3)               |                 |  |
| Partial factor $\gamma_{Ms}^{1)}$ [-]   |  |  | 1,25                |                 |                 |                 |                 |                  |                 |  |
| FH II-SK R  |  |  | $t_{fix}^{2)}$ [mm] | $\geq 10$       |                 | $\geq 15$       |                 | 3)               |                 |  |
|   |  |  | $V^0_{Rk,s}$ [kN]   | 18,0            | 33,0            | 59,0            | 76,0            |                  |                 |  |
|   |  |  | $t_{fix}^{2)}$ [mm] | $< 10$          |                 | $< 15$          |                 |                  |                 |  |
|   |  |  | $V^0_{Rk,s}$ [kN]   | 8,0             | 14,0            | 23,0            | 34,0            |                  |                 |  |
| Partial factor $\gamma_{Ms}^{1)}$ [-]   |  |  | 1,33                |                 |                 |                 |                 |                  |                 |  |
| Factor for ductility $k_7$  |  |  | 1,0                 |                 |                 |                 |                 |                  |                 |  |
| <b>Steel failure with lever arm and concrete pryout failure</b>   |  |  |                     |                 |                 |                 |                 |                  |                 |  |
| Characteristic bending resistance FH II-S, -SK, -B, -H $M^0_{Rk,s}$ [Nm]  |  |  | 12                  | 30              | 60              | 105             | 266             | 518              | 896             |  |
| Partial factor $\gamma_{Ms}^{1)}$ [-]   |  |  | 1,25                |                 |                 |                 |                 |                  |                 |  |
| Characteristic bending resistance FH II R $M^0_{Rk,s}$ [Nm]   |  |  | 12                  | 30              | 60              | 105             | 266             | 3)               |                 |  |
| Partial factor $\frac{FH II-B R, -H R}{FH II-S R, -SK R}$ $\gamma_{Ms}^{1)}$ [-]  |  |  | 1,25                |                 |                 |                 |                 |                  |                 |  |
|   |  |  | 1,33                |                 |                 |                 |                 |                  |                 |  |
| Factor for pryout failure $k_8$ [-]   |  |  | 1,0                 | 2,0             |                 |                 |                 |                  |                 |  |
| <b>Concrete edge failure</b>  |  |  |                     |                 |                 |                 |                 |                  |                 |  |
| Effective embedment depth for calculation $l_f =$ [mm]  |  |  | $h_{ef}$            |                 |                 |                 |                 |                  |                 |  |
| Outside diameter of a fastener $d_{nom}$  |  |  | 10                  | 12              | 15              | 18              | 24              | 28               | 32              |  |
| <sup>1)</sup> In absence of other national regulations<br><sup>2)</sup> The thickness of the fixture has influence to the characteristic resistance for shear loads, steel failure without lever arm<br><sup>3)</sup> No performance assessed |  |  |                     |                 |                 |                 |                 |                  |                 |  |
| fischer High-Performance Anchor FH II, FH II-I  |  |  |                     |                 |                 |                 |                 | <b>Annex C 3</b> |                 |  |
| <b>Performances</b><br>Performance characteristics of shear resistance for FH II and FH II R  |  |  |                     |                 |                 |                 |                 |                  |                 |  |

| <b>Table C4.1: Performance characteristics of shear resistance for FH II-I and FH II-I R under static and quasi-static loads</b> |                        |                          |                          |                           |                           |
|--|------------------------|--------------------------|--------------------------|---------------------------|---------------------------|
| Anchor type FH II-I and FH II-I R  |                        | <b>FH II<br/>12/M6 I</b> | <b>FH II<br/>12/M8 I</b> | <b>FH II<br/>15/M10 I</b> | <b>FH II<br/>15/M12 I</b> |
| Installation factor  | $\gamma_{inst}$ [-]    | 1,0                      |                          |                           |                           |
| <b>Steel failure without lever arm</b>   |                        |                          |                          |                           |                           |
| <b>Anchor in combination with screw / threaded rod of galvanised steel complying with DIN EN ISO 898:2013</b>                    |                        |                          |                          |                           |                           |
| Strength class 5.8   |                        | 5                        | 9                        | 15                        | 21                        |
| Strength class 6.8   | $V_{RK,s}^0$ [kN]      | 6                        | 11                       | 18                        | 24                        |
| Strength class 8.8   |                        | 8                        | 14                       | 23                        | 24                        |
| Partial factor   | $\gamma_{Ms}^{1)}$ [-] | 1,25                     |                          |                           |                           |
| Factor for ductility   | $k_7$                  | 1,0                      |                          |                           |                           |
| <b>Anchor in combination with screw / threaded rod of stainless steel complying with DIN EN ISO 3506:2010</b>                    |                        |                          |                          |                           |                           |
| Strength class A50   | $V_{RK,s}^0$ [kN]      | 5                        | 9                        | 15                        | 21                        |
| Partial factor   | $\gamma_{Ms}^{1)}$ [-] | 2,38                     |                          |                           |                           |
| Strength class A70   | $V_{RK,s}^0$ [kN]      | 7                        | 13                       | 20                        | 30                        |
| Partial factor   | $\gamma_{Ms}^{1)}$ [-] | 1,56                     |                          |                           |                           |
| Strength class A80   | $V_{RK,s}^0$ [kN]      | 8                        | 15                       | 23                        | 32                        |
| Partial factor   | $\gamma_{Ms}^{1)}$ [-] | 1,33                     |                          |                           |                           |
| Factor for ductility   | $k_7$                  | 1,0                      |                          |                           |                           |
| <b>Steel failure with lever arm and concrete pryout failure</b>  |                        |                          |                          |                           |                           |
| <b>Anchor in combination with screw / threaded rod of galvanised steel complying with DIN EN ISO 898:2013</b>                    |                        |                          |                          |                           |                           |
| Strength class 5.8   |                        | 8                        | 19                       | 37                        | 65                        |
| Strength class 6.8   | $M_{RK,s}^0$ [Nm]      | 9                        | 23                       | 44                        | 78                        |
| Strength class 8.8   |                        | 12                       | 30                       | 60                        | 105                       |
| Partial factor   | $\gamma_{Ms}^{1)}$ [-] | 1,25                     |                          |                           |                           |
| Factor for ductility   | $k_7$                  | 1,0                      |                          |                           |                           |
| <b>Anchor in combination with screw / threaded rod of stainless steel complying with DIN EN ISO 3506:2010</b>                    |                        |                          |                          |                           |                           |
| Strength class A50   | $M_{RK,s}^0$ [Nm]      | 8                        | 19                       | 37                        | 65                        |
| P Partial factor   | $\gamma_{Ms}^{1)}$ [-] | 2,38                     |                          |                           |                           |
| Strength class A70   | $M_{RK,s}^0$ [Nm]      | 11                       | 26                       | 52                        | 92                        |
| Partial factor   | $\gamma_{Ms}^{1)}$ [-] | 1,56                     |                          |                           |                           |
| Strength class A80   | $M_{RK,s}^0$ [Nm]      | 12                       | 30                       | 60                        | 105                       |
| Partial factor   | $\gamma_{Ms}^{1)}$ [-] | 1,33                     |                          |                           |                           |
| Factor for ductility   | $k_7$ [-]              | 1,0                      |                          |                           |                           |
| Factor for pryout failure  | $k_8$                  | 2,0                      |                          |                           |                           |
| <b>Concrete edge failure</b>   |                        |                          |                          |                           |                           |
| Effective embedment depth for calculation  | $l_f =$ [mm]           | $h_{ef}$                 |                          |                           |                           |
| Outside diameter of fastener   | $d_{nom}$              | 12                       |                          | 15                        |                           |
| 1) In absence of other national regulations  |                        |                          |                          |                           |                           |
| fischer High-Performance Anchor FH II, FH II-I   |                        |                          |                          | <b>Annex C 4</b>          |                           |
| <b>Performances</b><br>Performance characteristics of shear resistance for FH II-I and FH II-I R                                 |                        |                          |                          |                           |                           |

**Table C5.1:** Performance characteristics of **tension resistance** under **fire exposure**

| Anchor type                                     | R30                      |                          |                            | R60                       |                           |                             |
|---|--------------------------|--------------------------|----------------------------|---------------------------|---------------------------|-----------------------------|
|   | $N_{Rk,s,fi,30}$<br>[kN] | $N_{Rk,p,fi,30}$<br>[kN] | $N^0_{Rk,c,fi,30}$<br>[kN] | $N_{Rk,s,fi,60}$<br>[kN]  | $N_{Rk,p,fi,60}$<br>[kN]  | $N^0_{Rk,c,fi,60}$<br>[kN]  |
| FH II 10, FH II 10 R                            | 0,2                      | 1,8                      | 1,8                        | 0,2                       | 1,8                       | 1,8                         |
| FH II 12, FH II 12 R                            | 2,0                      | 3,0                      | 5,0                        | 1,3                       | 3,0                       | 5,0                         |
| FH II 15, FH II 15 R                            | 3,2                      | 4,0                      | 7,4                        | 2,3                       | 4,0                       | 7,4                         |
| FH II 18, FH II 18 R                            | 4,8                      | 6,3                      | 10,3                       | 3,9                       | 6,3                       | 10,3                        |
| FH II 24, FH II 24 R                            | 8,9                      | 9,0                      | 18,0                       | 7,3                       | 9,0                       | 18,0                        |
| FH II 28  | 13,9                     | 12,6                     | 31,4                       | 11,3                      | 12,6                      | 31,4                        |
| FH II 32  | 20,0                     | 16,5                     | 49,6                       | 16,3                      | 16,5                      | 49,6                        |
| FH II 12/M6-I, 5.8, A50 <sup>1)</sup>           | 0,1                      | 2,3                      | 5,0                        | 0,1                       | 2,3                       | 5,0                         |
| FH II 12/M6-I R 8.8, A70, A80 <sup>1) 2)</sup>  | 0,2                      |                          |                            | 0,2                       |                           |                             |
| FH II 12/M8-I, 5.8, A50 <sup>1)</sup>           | 1,3                      |                          |                            | 0,8                       |                           |                             |
| FH II 12/M8-I R 8.8, A70, A80 <sup>1) 2)</sup>  | 2,0                      |                          |                            | 1,3                       |                           |                             |
| FH II 15/M10-I, 5.8, A50 <sup>1)</sup>          | 2,0                      | 3,0                      | 7,4                        | 1,4                       | 3,0                       | 7,4                         |
| FH II 15/M10-I R 8.8, A70, A80 <sup>1) 2)</sup> | 3,2                      |                          |                            | 2,3                       |                           |                             |
| FH II 15/M12-I, 5.8/A50 <sup>1)</sup>           | 3,0                      |                          |                            | 2,4                       |                           |                             |
| FH II 15/M12-I R 8.8, A70, A80 <sup>1) 2)</sup> | 4,8                      |                          |                            | 3,9                       |                           |                             |
| Anchor type                                     | R90                      |                          |                            | R120                      |                           |                             |
|   | $N_{Rk,s,fi,90}$<br>[kN] | $N_{Rk,p,fi,90}$<br>[kN] | $N^0_{Rk,c,fi,90}$<br>[kN] | $N_{Rk,s,fi,120}$<br>[kN] | $N_{Rk,p,fi,120}$<br>[kN] | $N^0_{Rk,c,fi,120}$<br>[kN] |
| FH II 10, FH II 10 R                            | 0,1                      | 1,8                      | 1,8                        | 0,1                       | 1,5                       | 1,5                         |
| FH II 12, FH II 12 R                            | 0,6                      | 3,0                      | 5,0                        | 0,2                       | 2,4                       | 4,0                         |
| FH II 15, FH II 15 R                            | 1,4                      | 4,0                      | 7,4                        | 1,0                       | 3,2                       | 5,9                         |
| FH II 18, FH II 18 R                            | 3,0                      | 6,3                      | 10,3                       | 2,6                       | 5,0                       | 8,2                         |
| FH II 24, FH II 24 R                            | 5,6                      | 9,0                      | 18,0                       | 4,8                       | 7,2                       | 14,4                        |
| FH II 28  | 8,8                      | 12,6                     | 31,4                       | 7,5                       | 10,1                      | 25,2                        |
| FH II 32  | 12,6                     | 16,5                     | 49,6                       | 10,8                      | 13,2                      | 39,7                        |
| FH II 12/M6-I, 5.8, A50 <sup>1)</sup>           | 0,1                      | 2,3                      | 5,0                        | 0,1                       | 1,8                       | 4,0                         |
| FH II 12/M6-I R 8.8, A70, A80 <sup>1) 2)</sup>  | 0,1                      |                          |                            | 0,1                       |                           |                             |
| FH II 12/M8-I, 5.8, A50 <sup>1)</sup>           | 0,4                      |                          |                            | 0,1                       |                           |                             |
| FH II 12/M8-I R 8.8, A70, A80 <sup>1) 2)</sup>  | 0,6                      |                          |                            | 0,2                       |                           |                             |
| FH II 15/M10-I, 5.8, A50 <sup>1)</sup>          | 0,9                      | 3,0                      | 7,4                        | 0,6                       | 2,4                       | 5,9                         |
| FH II 15/M10-I R 8.8, A70, A80 <sup>1) 2)</sup> | 1,4                      |                          |                            | 1,0                       |                           |                             |
| FH II 15/M12-I, 5.8/A50 <sup>1)</sup>           | 1,9                      |                          |                            | 1,6                       |                           |                             |
| FH II 15/M12-I R 8.8, A70, A80 <sup>1) 2)</sup> | 3,0                      |                          |                            | 2,6                       |                           |                             |

<sup>1)</sup> Intermediate values by linear interpolation

<sup>2)</sup> In combination with screw / threaded rod strength class 8.8, A70, A80

fischer High-Performance Anchor FH II, FH II-I

**Performances**  
Performance characteristics of tension resistance under fire exposure

**Annex C 5**

**Table C6.1: Performance characteristics of shear resistance under fire exposure**

| Anchor type                                     | R30                      |                            | R60                       |                             |
|---|--------------------------|----------------------------|---------------------------|-----------------------------|
|   | $V_{Rk,s,fi,30}$<br>[kN] | $M^0_{Rk,s,fi,30}$<br>[Nm] | $V_{Rk,s,fi,60}$<br>[kN]  | $M^0_{Rk,s,fi,60}$<br>[Nm]  |
| FH II 10, FH II 10 R                            | 0,3                      | 0                          | 0,3                       | 0                           |
| FH II 12, FH II 12 R                            | 2,0                      | 2                          | 1,3                       | 1                           |
| FH II 15, FH II 15 R                            | 3,2                      | 4                          | 2,3                       | 3                           |
| FH II 18, FH II 18 R                            | 4,8                      | 7                          | 3,9                       | 6                           |
| FH II 24, FH II 24 R                            | 8,9                      | 19                         | 7,3                       | 15                          |
| FH II 28  | 13,9                     | 37                         | 11,3                      | 30                          |
| FH II 32  | 20,0                     | 64                         | 16,3                      | 52                          |
| FH II 12/M6 I, 5.8, A50 <sup>1)</sup>           | 0,2                      | 0                          | 0,2                       | 0                           |
| FH II 12/M6 I R 8.8, A70, A80 <sup>1) 2)</sup>  | 0,3                      | 0                          | 0,3                       | 0                           |
| FH II 12/M8 I, 5.8, A50 <sup>1)</sup>           | 1,3                      | 1                          | 0,8                       | 1                           |
| FH II 12/M8-I R 8.8, A70, A80 <sup>1) 2)</sup>  | 2,0                      | 2                          | 1,3                       | 1                           |
| FH II 15/M10 I, 5.8, A50 <sup>1)</sup>          | 2,0                      | 3                          | 1,4                       | 2                           |
| FH II 15/M10-I R 8.8, A70, A80 <sup>1) 2)</sup> | 3,2                      | 4                          | 2,3                       | 3                           |
| FH II 15/M12-I, 5.8/A50 <sup>1)</sup>           | 3,0                      | 4                          | 2,4                       | 4                           |
| FH II 15/M12-I R 8.8, A70, A80 <sup>1) 2)</sup> | 4,8                      | 7                          | 3,9                       | 6                           |
| Anchor type                                     | R90                      |                            | R120                      |                             |
|   | $V_{Rk,s,fi,90}$<br>[kN] | $M^0_{Rk,s,fi,90}$<br>[Nm] | $V_{Rk,s,fi,120}$<br>[kN] | $M^0_{Rk,s,fi,120}$<br>[Nm] |
| FH II 10, FH II 10 R                            | 0,2                      | 0                          | 0,1                       | 0                           |
| FH II 12, FH II 12 R                            | 0,6                      | 1                          | 0,2                       | 0                           |
| FH II 15, FH II 15 R                            | 1,4                      | 2                          | 1,0                       | 1                           |
| FH II 18, FH II 18 R                            | 3,0                      | 5                          | 2,6                       | 4                           |
| FH II 24, FH II 24 R                            | 5,6                      | 12                         | 4,8                       | 10                          |
| FH II 28  | 8,8                      | 23                         | 7,5                       | 20                          |
| FH II 32  | 12,6                     | 40                         | 10,8                      | 34                          |
| FH II 12/M6-I, 5.8, A50 <sup>1)</sup>           | 0,1                      | 0                          | 0,1                       | 0                           |
| FH II 12/M6-I R 8.8, A70, A80 <sup>1) 2)</sup>  | 0,2                      | 0                          | 0,1                       | 0                           |
| FH II 12/M8-I, 5.8, A50 <sup>1)</sup>           | 0,4                      | 1                          | 0,1                       | 0                           |
| FH II 12/M8-I R 8.8, A70, A80 <sup>1) 2)</sup>  | 0,6                      | 1                          | 0,2                       | 0                           |
| FH II 15/M10 I, 5.8, A50 <sup>1)</sup>          | 0,9                      | 2                          | 0,6                       | 1                           |
| FH II 15/M10-I R 8.8, A70, A80 <sup>1) 2)</sup> | 1,4                      | 3                          | 1,0                       | 1                           |
| FH II 15/M12 I, 5.8/A50 <sup>1)</sup>           | 1,9                      | 4                          | 1,6                       | 3                           |
| FH II 15/M12-I R 8.8, A70, A80 <sup>1) 2)</sup> | 3,0                      | 6                          | 2,6                       | 4                           |

<sup>1)</sup> Intermediate values by linear interpolation

<sup>2)</sup> In combination with screw / threaded rod strength class 8.8, A70, A80

**Table C6.2: Minimum spacings and minimum edge distances of anchors under fire exposure for tension and shear loads**

| Anchor type   | FH II 10  | FH II 12<br>FH II 12-I | FH II 15<br>FH II 15-I | FH II 18 | FH II 24 | FH II 28 | FH II 32 |
|---|---|------------------------|------------------------|----------|----------|----------|----------|
| Spacing $\frac{S_{cr,N,fi}}{S_{min,fi}}$            | 4x h <sub>ef</sub>  |                        |                        |          |          |          |          |
|   | 40  | 50                     | 60                     | 70       | 80       | 100      | 120      |
| Edge distance $\frac{C_{cr,N,fi}}{C_{min,fi}}$ [mm] | 2 x h <sub>ef</sub>   |                        |                        |          |          |          |          |
|   | C <sub>min,fi</sub> = 2 x h <sub>ef</sub> ,<br>for fire exposure from more than one side C <sub>min,fi</sub> ≥ 300 mm |                        |                        |          |          |          |          |

fischer High-Performance Anchor FH II, FH II-I

**Performances**

Performance characteristics of shear resistance under fire exposure

Minimum spacings and minimum edge distances of anchors under fire exposure

**Annex C 6**

**Table C7.1:** Minimum thickness of concrete member, minimum spacing and minimum edge distances  
**FH II, FH II R**

| Anchor type FH II-S, -SK, -B, -H and<br>FH II-S R, -SK R, -B R, -H R |                | <b>FH II<br/>10</b> | <b>FH II<br/>12</b> | <b>FH II<br/>15</b> | <b>FH II<br/>18</b> | <b>FH II<br/>24</b> | <b>FH II<br/>28</b> | <b>FH II<br/>32</b> |
|--|----------------|---------------------|---------------------|---------------------|---------------------|---------------------|---------------------|---------------------|
| Minimum thickness of concrete member                                 | $h_{min}$ [mm] | 80                  | 120                 | 140                 | 160                 | 200                 | 250                 | 300                 |
| Minimum spacing,<br>cracked concrete                                 | $s_{min}$      | 40                  | 50                  | 60                  | 70                  | 80                  | 100                 | 120                 |
|  | for $c \geq$   | 40                  | 80                  | 120                 | 140                 | 180                 | 200                 | 260                 |
| Minimum edge distance,<br>cracked concrete                           | $c_{min}$      | 40                  | 50                  | 60                  | 70                  | 80                  | 100                 | 120                 |
|  | for $s \geq$   | 40                  | 80                  | 120                 | 160                 | 200                 | 220                 | 280                 |
| Minimum spacing,<br>uncracked concrete                               | $s_{min}$      | 40                  | 60                  | 70                  | 80                  | 100                 | 120                 | 160                 |
|  | for $c \geq$   | 70                  | 100                 | 100                 | 160                 | 200                 | 220                 | 360                 |
| Minimum edge distance,<br>uncracked concrete                         | $c_{min}$      | 40                  | 60                  | 70                  | 80                  | 100                 | 120                 | 180                 |
|  | for $s \geq$   | 70                  | 100                 | 140                 | 200                 | 220                 | 240                 | 380                 |

Intermediate values may be calculated by linear interpolation

**Table C7.2:** Minimum thickness of concrete member, minimum spacing and minimum edge distances  
**FH II-I, FH II-I R**

| Anchor type FH II-I and FH II-I R            |                | <b>FH II 12/M6 I<br/>FH II 12/M8 I</b> | <b>FH II 15/M10 I<br/>FH II 15/M12 I</b> |
|--|----------------|--|--|
| Minimum thickness of concrete member         | $h_{min}$ [mm] | 125                                    | 150                                      |
| Minimum spacing,<br>cracked concrete         | $s_{min}$      | 50                                     | 60                                       |
|  | for $c \geq$   | 80                                     | 120                                      |
| Minimum edge distance,<br>cracked concrete   | $c_{min}$      | 50                                     | 60                                       |
|  | for $s \geq$   | 80                                     | 120                                      |
| Minimum spacing,<br>uncracked concrete       | $s_{min}$      | 60                                     | 70                                       |
|  | for $c \geq$   | 100                                    | 100                                      |
| Minimum edge distance,<br>uncracked concrete | $c_{min}$      | 60                                     | 70                                       |
|  | for $s \geq$   | 100                                    | 140                                      |

Intermediate values may be calculated by linear interpolation.

fischer High-Performance Anchor FH II, FH II-I

**Performances**  
Minimum thickness of concrete member, minimum spacing and minimum edge distances

**Annex C 7**

**Table C8.1:** Performance characteristics of **tension and shear resistance** for **seismic performance category C1** for FH II-S, -SK, -B, -H and FH II-S R, -SK R, -B R, -H R

| Anchor type FH II-S, -SK, -B, -H and FH II-S R, -SK R, -B R, -H R |                           | FH II<br>12               | FH II<br>15 | FH II<br>18 | FH II<br>24 | FH II<br>28 | FH II<br>32 |      |  |
|---|---------------------------|---------------------------|-------------|-------------|-------------|-------------|-------------|------|--|
| <b>Steel failure</b>  |                           |                           |             |             |             |             |             |      |  |
| Characteristic resistance of tension load<br><b>C1</b>            | FH II-S, -B               | 29,3                      | 46,4        | 67,4        | 125,3       | 195,8       | 282,0       |      |  |
|   | FH II-H, -H R, -B R       | 29,3                      | 46,4        | 67,4        | 125,3       | 3)          |             |      |  |
|   | FH II-SK                  | 29,3                      | 46,4        | 67,4        | 3)          |             |             |      |  |
|   | Partial factor            | $\gamma_{Ms,C1}^{1)}$ [-] | 1,5         |             |             |             |             |      |  |
|   | FH II-S R                 | 29,3                      | 46,4        | 67,4        | 125,3       | 3)          |             |      |  |
|   | FH II-SK R                | 29,3                      | 46,4        | 67,4        | 3)          |             |             |      |  |
|   | Partial factor            | $\gamma_{Ms,C1}^{1)}$ [-] | 1,6         |             |             |             |             |      |  |
| <b>Pullout failure</b>  |                           |                           |             |             |             |             |             |      |  |
| Characteristic resistance of tension load in cracked concrete C1  |                           | $N_{Rk,p,C1}$ [kN]        | 12,0        | 16,0        | 25,0        | 36,0        | 50,3        | 66,1 |  |
|   |                           | $\gamma_{Mp,C1}^{1)}$ [-] | 1,5         |             |             |             |             |      |  |
| <b>Steel failure without lever arm</b>                            |                           |                           |             |             |             |             |             |      |  |
| <b>Characteristic resistance of shear load C1</b>                 |                           |                           |             |             |             |             |             |      |  |
| FH II-S   | $V_{Rk,s,C1}$ [kN]        | 25,0                      | 41,0        | 60,0        | 123,0       | 141,0       | 200,0       |      |  |
| FH II-B   |                           | 17,0                      | 30,0        | 46,0        | 103,0       | 117,0       | 169,0       |      |  |
| FH II-H   |                           | 17,0                      | 30,0        | 46,0        | 103,0       |             |             |      |  |
| FH II-SK  | $t_{fix}^{2)}$ [mm]       | $\geq 10$                 | $\geq 15$   |             | 3)          |             |             |      |  |
|   | $V_{Rk,s,C}$ [kN]         | 25,0                      | 41,0        | 60,0        |             |             |             |      |  |
|   | $t_{fix}^{2)}$ [mm]       | $< 10$                    | $< 15$      |             |             |             |             |      |  |
|   | $V_{Rk,s,C}$ [kN]         | 11,0                      | 16,0        | 27,0        |             |             |             |      |  |
| Partial factor  | $\gamma_{Ms,C1}^{1)}$ [-] | 1,25                      |             |             |             |             |             |      |  |
| FH II-S R   | $V_{Rk,s,C1}$ [kN]        | 25,0                      | 41,0        | 60,0        | 123,0       | -           |             |      |  |
| Partial factor  | $\gamma_{Ms,C1}^{1)}$ [-] | 1,33                      |             |             |             |             |             |      |  |
| FH II-B R, -H R   | $V_{Rk,s,C1}$ [kN]        | 17,0                      | 30,0        | 46,0        | 103,0       | -           |             |      |  |
| Partial factor  | $\gamma_{Ms,C1}^{1)}$ [-] | 1,25                      |             |             |             |             |             |      |  |
| FH II-SK R  | $t_{fix}^{2)}$ [mm]       | $\geq 10$                 | $\geq 15$   |             | 3)          |             |             |      |  |
|   | $V_{Rk,s,C1}$ [kN]        | 25,0                      | 41,0        | 60,0        |             |             |             |      |  |
|   | $t_{fix}^{2)}$ [mm]       | $< 10$                    | $< 15$      |             |             |             |             |      |  |
|   | $V_{Rk,s,C1}$ [kN]        | 11,0                      | 16,0        | 27,0        |             |             |             |      |  |
| Partial factor  | $\gamma_{Ms,C1}^{1)}$ [-] | 1,33                      |             |             |             |             |             |      |  |
| Factor for annular gap  | $\alpha_{gap}$            | 0,50                      |             |             |             |             |             |      |  |

<sup>1)</sup> In absence of other national regulations

<sup>2)</sup> The thickness of the fixture has influence to the characteristic resistance for shear loads, steel failure without lever arm

<sup>3)</sup> No performance assessed

fischer High-Performance Anchor FH II, FH II-I

**Performances**  
Performance characteristics of tension and shear resistance for seismic performance category C1

**Annex C 8**

**Table C9.1:** Performance characteristics of **tension and shear resistance** for **seismic performance category C2** for FH II-S, -SK, -B, -H and FH II-S R, -SK R, -B R, -H R

| Anchor type FH II-S, -SK, -B, -H and FH II-S R, -SK R, -B R, -H R |                       |                       |           | FH II<br>12           | FH II<br>15 | FH II<br>18 | FH II<br>24 | FH II<br>28 | FH II<br>32 |      |
|---|-----------------------|-----------------------|-----------|-----------------------|-------------|-------------|-------------|-------------|-------------|------|
| <b>Steel failure</b>  |                       |                       |           |                       |             |             |             |             |             |      |
| Characteristic resistance of tension load <b>C2</b>               | FH II-S, -B           | $N_{Rk,s,C2}$         | [kN]      | 29,3                  | 46,4        | 67,4        | 125,3       | 195,8       |             |      |
|   | FH II-H, -H R, -B R   |                       |           | 29,3                  | 46,4        | 67,4        | 125,3       | 3)          |             |      |
|   | FH II-SK              |                       |           | 29,3                  | 46,4        | 67,4        | 3)          |             |             |      |
|   | Partial factor        | $\gamma_{Ms,C2}^{1)}$ | [-]       | 1,5                   |             |             |             |             |             |      |
|   | FH II-S R             | $N_{Rk,s,C2}$         | [kN]      | 29,3                  | 46,4        | 67,4        | 125,3       | 3)          |             |      |
|   | FH II-SK R            |                       |           | 29,3                  | 46,4        | 67,4        | 3)          |             |             |      |
|   | Partial factor        | $\gamma_{Ms,C2}^{1)}$ | [-]       | 1,6                   |             |             |             |             |             |      |
| <b>Pullout failure</b>  |                       |                       |           |                       |             |             |             |             |             |      |
| Characteristic resistance of tension load in cracked concrete C2  |                       |                       |           | $N_{Rk,p,C2}$         | [kN]        | 6,2         | 11,3        | 21,8        | 43,0        | 65,9 |
|   |                       |                       |           | $\gamma_{Mp,C2}^{1)}$ | [-]         | 1,5         |             |             |             |      |
| <b>Steel failure without lever arm</b>                            |                       |                       |           |                       |             |             |             |             |             |      |
| <b>Characteristic resistance of shear load C2</b>                 |                       |                       |           |                       |             |             |             |             |             |      |
| FH II-S   | $V_{Rk,s,C2}$         | [kN]                  | 14,7      | 28,9                  | 41,0        | 100,7       |             |             |             |      |
| FH II-B   |                       |                       | 9,8       | 20,9                  | 34,1        | 61,9        | 67,2        |             |             |      |
| FH II-H   |                       |                       | 9,8       | 20,9                  | 34,1        | 61,9        | 3)          |             |             |      |
| FH II-SK  | $t_{fix}^{2)}$        | [mm]                  | $\geq 10$ | $\geq 15$             |             | 3)          |             |             |             |      |
|   | $V_{Rk,s,C2}$         | [kN]                  | 14,8      | 23,3                  | 33,8        |             |             |             |             |      |
|   | $t_{fix}^{2)}$        | [mm]                  | $< 10$    | $< 15$                |             |             |             |             |             |      |
|   | $V_{Rk,s,C2}$         | [kN]                  | 6,3       | 9,1                   | 15,1        |             |             |             |             |      |
| Partial factor  | $\gamma_{Ms,C2}^{1)}$ | [-]                   | 1,25      |                       |             |             |             |             |             |      |
| FH II-S R   | $V_{Rk,s,C2}$         | [kN]                  | 14,7      | 28,9                  | 41,0        | 100,7       | 3)          |             |             |      |
| Partial factor  | $\gamma_{Ms,C2}^{1)}$ | [-]                   | 1,33      |                       |             |             |             |             |             |      |
| FH II-B R, -H R   | $V_{Rk,s,C2}$         | [kN]                  | 9,8       | 20,9                  | 34,1        | 61,9        | 3)          |             |             |      |
| Partial factor  | $\gamma_{Ms,C2}^{1)}$ | [-]                   | 1,25      |                       |             |             |             |             |             |      |
| FH II-SK R  | $t_{fix}^{2)}$        | [mm]                  | $\geq 10$ | $\geq 15$             |             | 3)          |             |             |             |      |
|   | $V_{Rk,s,C2}$         | [kN]                  | 14,8      | 23,3                  | 33,8        |             |             |             |             |      |
|   | $t_{fix}^{2)}$        | [mm]                  | $< 10$    | $< 15$                |             |             |             |             |             |      |
|   | $V_{Rk,s,C2}$         | [kN]                  | 6,3       | 9,1                   | 15,1        |             |             |             |             |      |
| Partial factor  | $\gamma_{Ms,C2}^{1)}$ | [-]                   | 1,33      |                       |             |             |             |             |             |      |
| Factor for annular gap  | $\alpha_{gap}$        | [-]                   | 0,50      |                       |             |             |             |             |             |      |

1) In absence of other national regulations

2) The thickness of the fixture has influence to the characteristic resistance for shear loads, steel failure without lever arm

3) No performance assessed

fischer High-Performance Anchor FH II, FH II-I

**Performances**  
Performance characteristics of tension and shear resistance for seismic performance category C2

**Annex C 9**

| <b>Table C10.1:</b> Displacements under static and quasi static <b>tension loads</b> for FH II and FH II R |  |      |          |          |          |          |          |          |          |
|--|--|------|----------|----------|----------|----------|----------|----------|----------|
| Anchor type FH II-S, -SK, -B, -H and FH II-S R, -SK R, -B R, -H R  |  |      | FH II 10 | FH II 12 | FH II 15 | FH II 18 | FH II 24 | FH II 28 | FH II 32 |
| Tension load cracked concrete  | N                                      | [kN] | 3,6      | 5,7      | 7,6      | 11,9     | 17,1     | 24,0     | 31,5     |
| Corresponding displacements  | $\frac{\delta_{N0}}{\delta_{N\infty}}$ | [mm] | 1,0      | 1,0      | 1,0      | 1,0      | 1,0      | 0,7      | 0,7      |
|  |  |      | 1,7      | 1,6      | 1,6      | 1,6      | 1,8      | 1,3      | 1,1      |
| Tension load uncracked concrete  | N                                      | [kN] | 6,0      | 11,2     | 14,1     | 17,2     | 24,0     | 33,6     | 44,2     |
| Corresponding displacements  | $\frac{\delta_{N0}}{\delta_{N\infty}}$ | [mm] | 0,6      | 1,0      | 1,0      | 1,0      | 1,0      | 0,3      | 0,3      |
|  |  |      | 1,7      | 1,6      | 1,6      | 1,6      | 1,8      | 1,3      | 1,1      |

| <b>Table C10.2:</b> Displacements under static and quasi static <b>tension loads</b> for FH II-I and FH II-I R |  |      |                                |                                  |
|--|--|------|--------------------------------|----------------------------------|
| Anchor type FH II-I and FH II-I R  |  |      | FH II 12/M6 I<br>FH II 12/M8 I | FH II 15/M10 I<br>FH II 15/M12 I |
| Tension load cracked concrete  | N                                      | [kN] | 4,3                            | 5,7                              |
| Tension load uncracked concrete  |  |      | 9,5                            | 14,1                             |
| Corresponding displacements  | $\frac{\delta_{N0}}{\delta_{N\infty}}$ | [mm] | 1,7                            | 1,9                              |
|  |  |      | 2,2                            | 2,9                              |

| <b>Table C10.3:</b> Displacements under static and quasi static <b>shear loads</b> for FH II-S and FH II-SK |  |      |          |          |          |          |          |          |          |
|---|--|------|----------|----------|----------|----------|----------|----------|----------|
| Anchor type FH II-S and FH II-SK  |  |      | FH II 10 | FH II 12 | FH II 15 | FH II 18 | FH II 24 | FH II 28 | FH II 32 |
| Shear load in cracked and uncracked concrete  | V                                      | [kN] | 10,3     | 18,9     | 33,7     | 43,4     | 83,4     | 99,4     | 124,0    |
| Corresponding displacements   | $\frac{\delta_{V0}}{\delta_{V\infty}}$ | [mm] | 2,4      | 2,7      | 4,4      | 5,0      | 7,0      | 6,0      | 8,0      |
|   |  |      | 3,6      | 4,1      | 6,6      | 7,5      | 10,5     | 9,0      | 12,0     |

| <b>Table C10.4:</b> Displacements under static and quasi static <b>shear loads</b> for FH II-B and FH II-H |  |      |          |          |          |          |          |          |          |
|--|--|------|----------|----------|----------|----------|----------|----------|----------|
| Anchor type FH II-B and FH II-H  |  |      | FH II 10 | FH II 12 | FH II 15 | FH II 18 | FH II 24 | FH II 28 | FH II 32 |
| Shear load in cracked and uncracked concrete   | V                                      | [kN] | 8,9      | 15,4     | 23,4     | 35,4     | 68,0     | 83,4     | 96,6     |
| Corresponding displacements  | $\frac{\delta_{V0}}{\delta_{V\infty}}$ | [mm] | 2,2      | 2,3      | 3,0      | 5,0      | 7,0      | 5,0      | 5,0      |
|  |  |      | 3,3      | 3,5      | 4,5      | 7,5      | 10,5     | 7,5      | 7,5      |

|  |                   |
|--|-------------------|
| fischer High-Performance Anchor FH II, FH II-I                     | <b>Annex C 10</b> |
| <b>Performances</b><br>Displacements under tension and shear loads |                   |



| <b>Table C11.1: Displacements under static and quasi static shear loads for FH II-S R, FH II-SK R, FH II-B R and FH II-H R</b> |   |                  |                  |                   |                   |                   |             |
|--|---|------------------|------------------|-------------------|-------------------|-------------------|-------------|
| Anchor type<br>FH II-S R, -SK R, -B R, -H R  |   | FH II<br>10      | FH II<br>12      | FH II<br>15       | FH II<br>18       | FH II<br>24       |             |
| Shear load in cracked and uncracked concrete   | V [kN]                                      | 10,3             | 16,0             | 24,6              | 37,7              | 68,0              |             |
| Corresponding displacements  | $\frac{\delta_{V0}}{\delta_{V\infty}}$ [mm] | 3,5              | 3,5              | 3,7               | 5,7               | 9,0               |             |
|  |   | 5,3              | 5,3              | 5,6               | 8,6               | 13,5              |             |
| <b>Table C11.2: Displacements under static and quasi static shear loads for FH II-I and FH II-I R</b>                          |   |                  |                  |                   |                   |                   |             |
| Anchor type: FH II-I and FH II-I R   |   | FH II<br>12/M6 I | FH II<br>12/M8 I | FH II<br>15/M10 I | FH II<br>15/M12 I |                   |             |
| Shear load in cracked and uncracked concrete   | V [kN]                                      | 4,6              | 8,3              | 13,3              | 13,7              |                   |             |
| Corresponding displacements  | $\frac{\delta_{V0}}{\delta_{V\infty}}$ [mm] | 2,6              | 2,6              | 2,2               | 2,2               |                   |             |
|  |   | 3,9              | 3,9              | 3,3               | 3,3               |                   |             |
| <b>Table C11.3: Displacements under tension loads for seismic performance category C2 for FH II and FH II R</b>                |   |                  |                  |                   |                   |                   |             |
| Anchor type FH II-S, -SK, -B, -H and FH II-S R, -SK R, -B R, -H R  |   | FH II<br>12      | FH II<br>15      | FH II<br>18       | FH II<br>24       | FH II<br>28       | FH II<br>32 |
| Displacement DLS   | $\delta_{N,C2 (DLS)}$ [mm]                  | 1,55             | 2,63             | 2,04              | 4,26              | 3,06              |             |
| Displacement ULS   | $\delta_{N,C2 (ULS)}$                       | 8,71             | 11,07            | 7,30              | 11,70             | 11,44             |             |
| <b>Table C11.4: Displacements under shear loads for seismic performance category C2 for FH II and FH II R</b>                  |   |                  |                  |                   |                   |                   |             |
| Anchor type FH II-S, -SK and FH II-S R, -SK R  |   | FH II<br>12      | FH II<br>15      | FH II<br>18       | FH II<br>24       | FH II<br>28       | FH II<br>32 |
| Displacement DLS   | $\delta_{V,C2 (DLS)}$ [mm]                  | 3,53             | 4,18             | 4,67              | 5,59              | 4,79              |             |
| Displacement ULS   | $\delta_{V,C2 (ULS)}$                       | 6,62             | 7,38             | 9,03              | 14,09             | 9,95              |             |
| Anchor type FH II-B, -H and FH II-B R, -H R  |   | FH II<br>12      | FH II<br>15      | FH II<br>18       | FH II<br>24       | FH II<br>28       | FH II<br>32 |
| Displacement DLS   | $\delta_{V,C2 (DLS)}$ [mm]                  | 3,42             | 4,26             | 4,29              | 4,79              |                   |             |
| Displacement ULS   | $\delta_{V,C2 (ULS)}$                       | 5,26             | 6,66             | 7,95              | 7,69              | 9,95              |             |
| fischer High-Performance Anchor FH II, FH II-I   |   |                  |                  |                   |                   | <b>Annex C 11</b> |             |
| <b>Performances</b><br>Displacements under tension and shear loads   |   |                  |                  |                   |                   |                   |             |